


TYPICAL DIRECT BURIED
UTILITY TRENCH

Road Side


House Side

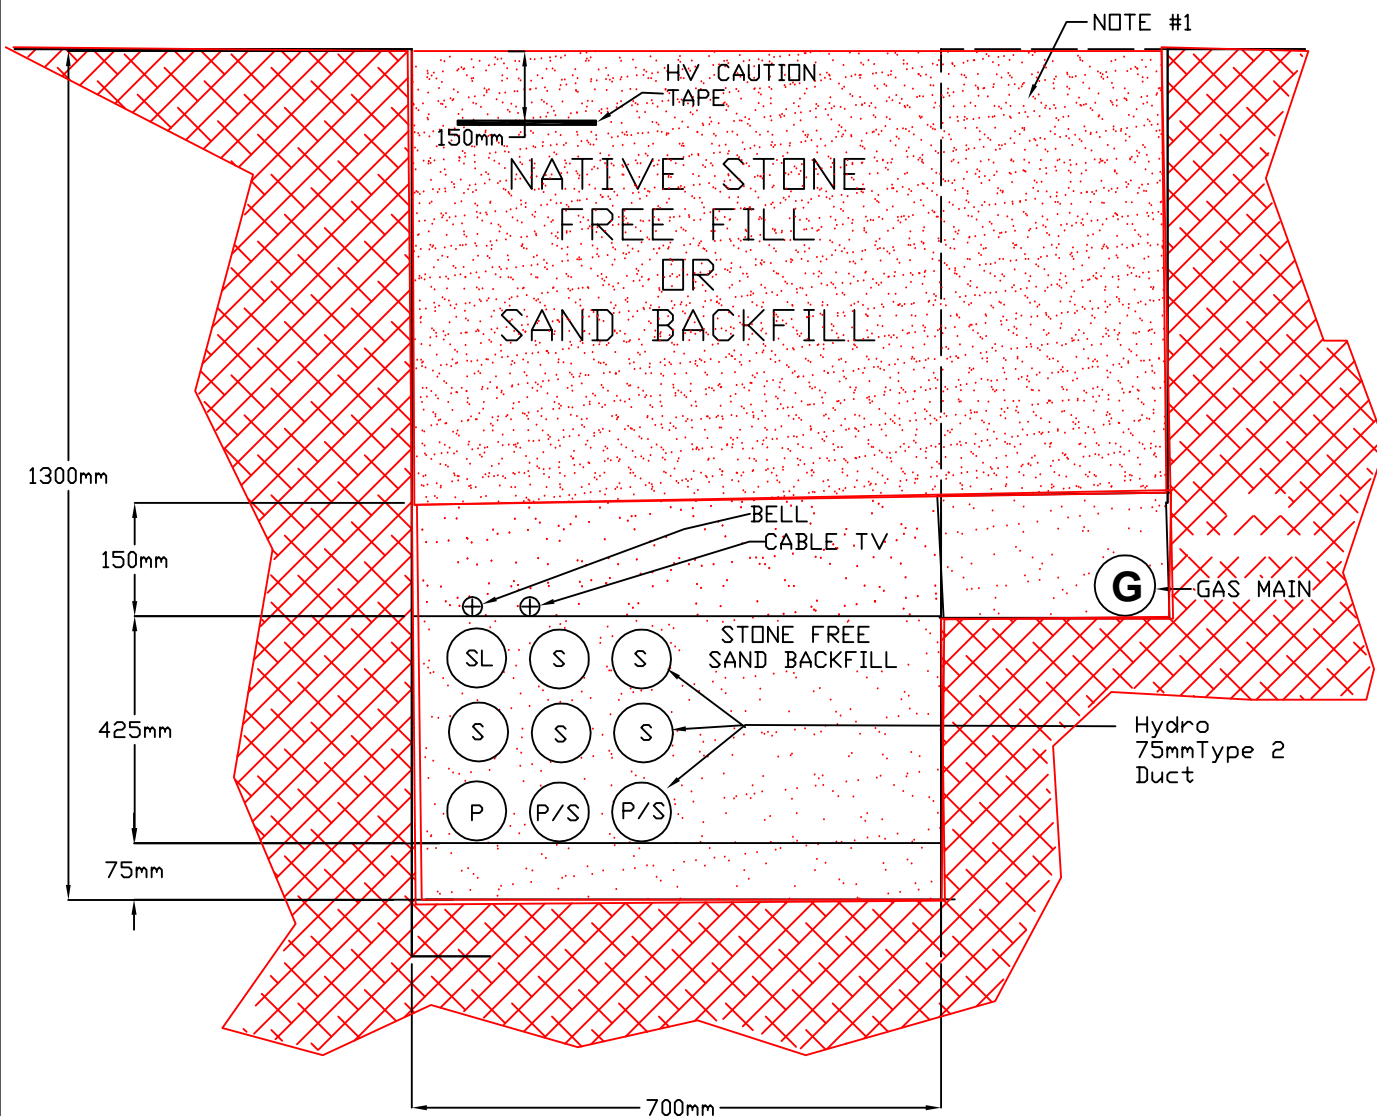

NOTES:

1. FOR JOINT USE TRENCH WITH GAS, THE GAS MAIN IS TO BE PLACED ON A SHELF ON THE HOUSE SIDE WITH A 1m CLEARANCE MAINTAINED TO HIGH VOLTAGE CABLES.

2. THE POSITION OF ALL POLE LINES, CONDUITS, WATER MAINS SEWERS, AND OTHER UNDERGROUND AND ABOVE GROUND UTILITIES AND STRUCTURES ARE NOT NECESSARILY AS SHOWN. THE ACCURACY OF THE POSITION OF SUCH UTILITIES AND STRUCTURES IS NOT GUARANTEED. BEFORE STARTING WORK, DETERMINE THE EXACT LOCATION OF ALL SUCH UTILITIES AND STRUCTURES AND ASSUME ALL LIABILITY FOR DAMAGE TO THEM.

	OTTAWA RIVER POWER CORPORATION		
	UTILITY TRENCH CROSS SECTION		
DWN. ALEX REAVIE	DWG NO. SDUG005	REV 1	
APP. DOUG FEE P. ENG.	SCALE NTS	SHEET	
DATE MAY 29, 2006			

Revisions:
1. OCT 22-06 General rev of trench cross section